View NSN Online: https://aerobasegroup.es/nsn/8010-00-298-2295

PRAXAIR INC -- ENAMEL ALKYD GLOSS GREEN 14064 -- 8010-00-298-2295

Product ID: ENAMEL ALKYD GLOSS GREEN 14064

MSDS Date:01/01/1987

FSC:8010

NIIN:00-298-2295

MSDS Number: BDWJS
=== Responsible Party ===
Company Name:PRAXAIR INC
Address:39 OLD RIDGEBURY RD

Box:2153

City:DANBURY

State:CT

ZIP:06817-0001

Country:US

Info Phone Num:203-794-5782 Emergency Phone Num:203-794

-5782

CAGE:0LV01

=== Contractor Identification ===

Company Name: PRATT AND LAMBERT INC

Box:6027

City:CLEVELAND

State:OH

ZIP:44101-1027

Country:US

Phone:216-566-2902

CAGE:61196

Company Name:PRAXAIR, INC. Address:39 OLD RIDGEBURY RD

Box:City:DANBURY

State:CT

ZIP:06810-5113

Country:US

Phone:800-772-9247; 800-PRAXAIR

CAGE:0LV01

====== Composition/Information on Ingredients ========


Ingred Name: *MINERAL SPIRITS

CAS:64475-85-0 RTECS #:PY8240000 ACGIH TLV:100PPM

Ingred Name: XYLENES (O-,

M-,P-1SOMERS) (SARA III) CAS:1330-20-7 RTECS #:ZE2100000 OSHA PEL:100 PPM/150 STEL ACGIH TLV:100 PPM/150STEL;9192 EPA Rpt Qty:1000 LBS DOT Rpt Qty:1000 LBS
Ingred Name:IRON OXIDE CAS:1332-37-2 RTECS #:NO7380000
Ingred Name:CARBON BLACK CAS:1333-86-4 RTECS #:FF5800000 OSHA PEL:3.5 MG/M3 ACGIH TLV:3.5 MG/M3; 9192
======================================
Effects of Overexposure:MATRL INTO LUNGS CAN CAUSE CHEM PNEUMONITIS WHICH CAN BE FATAL.INHAL:NAUSEA,UNCONSCIO US,EVN ASPHYXIA
======================================
First Aid:SWALLOWED:INDUC VOMIT IMMED.GIVNG 2 GLASES OF WATER & STICKING FINGER DOWN THROAT.CONSULT DR OR POISON CONTROL CENTR IMMED.(NVR GIVE ANYTHING BY MOUTH TO AN UNCONSCIOUS PERSON.)INHAL:REMOV TO FRESH AI R IMMED.IF BREATH HAS STOP,GIVE ARTIF RESPIRATION
======================================
Flash Point:80F,27C Extinguishing Media:CL B FIRE EXTING(CO*2,ALL PURPOS DRY CHEM OR ALCOH FOAM)
Fire Fighting Procedures:FIREFIGHTERS SHOULD WEAR SELF-CONTND BREATHING
APPARATUS. Unusual Fire/Explosion Hazard: KP CONTNRS TIGHTLY CLOS. ISOLAT FR HEAT, ELECT EQPMT, SPARKS & FLAME CLOS CONTNRS MAY EXPLOD EXPOS (SUP
========== Accidental Release Measures ===========
Spill Release Procedures:KEEP SPECTATORS AWAY.ELIM ALL IGNIT SOURCES

Spill Release Procedures:KEEP SPECTATORS AWAY.ELIM ALL IGNIT SOURCES (FLAMES,HOT SURFACES & SOURCES OF ELECTR,STATIC OR FRICTIONAL SPARKS).DIKE & CONTN SPILL W/INER

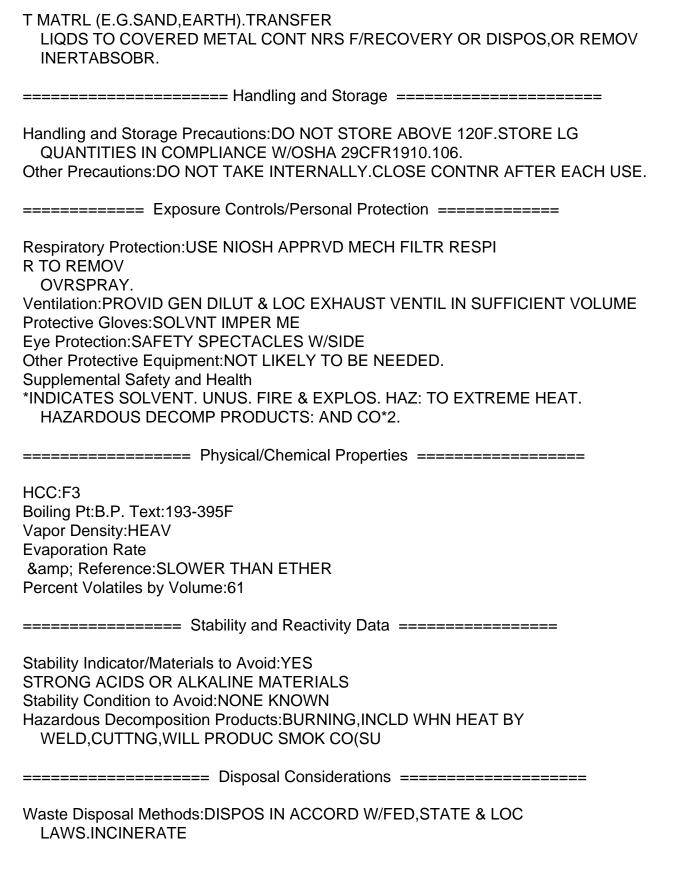

ONLY IN EPA PERMITTED FACILITY.DO NOT INCIN CLOS
CONTNRS.OBSERV PRECAUTIONS F/DISPOS OF FLAMMBL MATRLS.CONTAMINATED
ABSORBANT MAY BE DISPOS IN A HAZ WASTE LANDFILL.

Disclaimer (provided with this information by the compiling agencies): This information is formulated for use by elements of the Department of Defense. The United States of America in no manner whatsoever, expressly or implied, warrants this information to be accurate and disclaims all liability for its use. Any pers on utilizing this

document should seek competent professional advice to verify and assume responsibility for the suitability of this information to their particular situation.